KEVEIVED

U.S. DEPARTMENT OF HOMELAND SECURITY Federal Emergency Management Agency National Flood Insurance Program

JUL - 2 2018

OMB No. 1660-0008 Expiration Date: November 30, 2018

Copy all pages of this Elevation Certificate and all attachments for (1) community official, (2) insurance agent/company, and (3) building owner.

SECTION A - PROPERTY IN	FORMATION		FOR INSUR	ANCE COMPANY USE
A1. Building Owner's Name				per:
Dent & McBride				
Building Street Address (including Apt., Unit, Suite, a Box No.     10006 Corinthian Drive	and/or Bldg. No.) o	P.O. Route and	Company N	AIC Number:
City	State		ZIP Code	
Borough of Stone Harbor	New Jers	ey	08247	
A3. Property Description (Lot and Block Numbers, Tax F	Parcel Number, Leg	al Description, etc.	.)	
Lot 470 in Block 200.03				
A4. Building Use (e.g., Residential, Non-Residential, Ad	dition, Accessory, e			
A5. Latitude/Longitude: Lat. 39°03'09.7" Lo	ong. <u>-74°45'57.4"</u>	Horizontal	Datum: 🔲 NAD 1	927 🗵 NAD 1983
A6. Attach at least 2 photographs of the building if the C	Certificate is being u	sed to obtain flood	insurance.	
A7. Building Diagram Number 8				
A8. For a building with a crawlspace or enclosure(s):				
a) Square footage of crawlspace or enclosure(s)		788.00 sq ft		
b) Number of permanent flood openings in the crawl	Ispace or enclosure	(s) within 1.0 foot a	above adjacent gra	de 7
c) Total net area of flood openings in A8.b	1400.00 sq in			
d) Engineered flood openings? X Yes No				
A9. For a building with an attached garage:				
a) Square footage of attached garage	sq ft			
b) Number of permanent flood openings in the attack	hed garage within 1	.0 foot above adja	cent grade	<u></u>
c) Total net area of flood openings in A9.b	sq	,		 :
d) Engineered flood openings?				
SECTION B - FLOOD INS	SURANCE RATE	MAP (FIRM) INFO	RMATION	
B1. NFIP Community Name & Community Number Borough of Stone Harbor 345323	B2. County I			B3. State New Jersey
Borougil of Storie Harbor 343323				
B4. Map/Panel B5. Suffix B6. FIRM Index B Date	7. FIRM Panel Effective/	B8. Flood Zone(s)	B9. Base Flood El (Zone AO, use	evation(s) Base Flood Depth)
34009C0242 F 10-05-2017 10	Revised Date 0-05-2017	AE	9	
B10. Indicate the source of the Base Flood Elevation (Bi	FE) data or base flo	ood depth entered i	in Item B9:	
FIS Profile X FIRM Community Determin	ned	rce:		
B11. Indicate elevation datum used for BFE in Item B9:	☐ NGVD 1929 [	⊠ NAVD 1988 [	Other/Source:	
B12. Is the building located in a Coastal Barrier Resource	ces System (CBRS)	area or Otherwise	e Protected Area (C	PA)? ☐ Yes ⊠ No
	BRS   OPA			
				:

# **ELEVATION CERTIFICATE**

OMB No. 1660-0008 Expiration Date: November 30, 2018

IMPORTANT: In these spaces, copy the c	corresponding information from Sec	tion A.			E COMPANY USE
Building Street Address (including Apt., Uni 10006 Corinthian Drive	t, Suite, and/or Bldg. No.) or P.O. Rout	e and Box No.	Policy Nu		
City Borough of Stone Harbor	State ZIP 0 New Jersey 0824		Company	NAIC N	lumber
SECTION C - E	BUILDING ELEVATION INFORMAT	ION (SURVEY RE	QUIRED)		
C1. Building elevations are based on:  *A new Elevation Certificate will be re  C2. Elevations – Zones A1–A30, AE, AH, Complete Items C2.a–h below accord Benchmark Utilized: NJTCM-Ref 033  Indicate elevation datum used for the  NGVD 1929 × NAVD 19	Construction Drawings* Build equired when construction of the building A (with BFE), VE, V1–V30, V (with BF ding to the building diagram specified in Vertical Datum: Left delevations in items a) through h) below	ling Under Construg is complete. E), AR, AR/A, AR/A, Item A7. In Puerto N.A.V.D 1988	ction* [> AE, AR/A1 o Rico only Check	-A30, A	asurement used.
a) Top of bottom floor (including base	ement, crawlspace, or enclosure floor)		6.80 ×	_	meters
b) Top of the next higher floor			11.10	[] feet	meters
c) Bottom of the lowest horizontal str	uctural member (V Zones only)		N/A	] feet	meters
d) Attached garage (top of slab)			N/A	_ feet	meters
<ul> <li>e) Lowest elevation of machinery or (Describe type of equipment and leaves)</li> </ul>	equipment servicing the building ocation in Comments)		11.00	_	meters
f) Lowest adjacent (finished) grade r	next to building (LAG)		6.70 ×	feet	meters
g) Highest adjacent (finished) grade	next to building (HAG)		6.70 ×	feet	meters
<ul> <li>h) Lowest adjacent grade at lowest e structural support</li> </ul>	elevation of deck or stairs, including		6.60 ×	[] feet	meters
SECTION D -	SURVEYOR, ENGINEER, OR ARC	HITECT CERTIFI	CATION		
This certification is to be signed and seale I certify that the information on this Certific statement may be punishable by fine or in Were latitude and longitude in Section A p	eate represents my best efforts to interp aprisonment under 18 U.S. Code, Secti	oret the data avalla ion 1001. 	pie. I unae	rstana t	ation information.  hat any false  if attachments.
Certifier's Name	License Number				
Stephen C. Martinelli	30089				
Title Professional Land Surveyor				P	lace
Company Name Stephen C. Martinelli Land Surveying, LLC	2				ieal .
Address 1217 S.Shore Road Suite 106				The re	lere
City Ocean View	State New Jersey	ZIP Code 08230			
Signature	Date 06-27-2018	Telephone (609) 390-9618	Ext.		
Copy all pages of this Elevation Certificate a	and all attachments for (1) community off	icial, (2) insurance	agent/comp	oany, an	d (3) building owner.
Comments (including type of equipment at There are (7) Smart Vents Model #1540-5 located on a raised platform outside the Br CK by:SCM(fjs)	20 located in the foundation of the buil	ding.(See Attached	d). Lowest	machine	ery is the A/C units

# **ELEVATION CERTIFICATE**

OMB No. 1660-0008 Expiration Date: November 30, 2018

IMPORTANT: In these spaces, copy the correspond	ding information	from Section A.		ANCE COMPANY USE
Building Street Address (including Apt., Unit, Suite, an 10006 Corinthian Drive	d/or Bldg. No.) or			
City	State	ZIP Code	Company NA	AIC Number
Borough of Stone Harbor	New Jersey	08247		
SECTION E – BUILDING EI FOR ZON	LEVATION INFO IE AO AND ZONI	RMATION (SURVEY I E A (WITHOUT BFE)	NOT REQUIRED)	
For Zones AO and A (without BFE), complete Items E complete Sections A, B,and C. For Items E1–E4, use enter meters.	natural grade, if av	vailable. Check the mea	surement used. In	Puerto Rico only,
E1. Provide elevation information for the following and the highest adjacent grade (HAG) and the lowest a) Top of bottom floor (including basement,	d check the appropadicate (L.	oriate boxes to show wh AG).	ether the elevatior	n is above or below
crawlspace, or enclosure) is		feet n	neters 🗌 above	or   below the HAG.
<ul> <li>b) Top of bottom floor (including basement, crawlspace, or enclosure) is</li> </ul>		feet n	neters 🗌 above	or
E2. For Building Diagrams 6–9 with permanent flood	openings provided	in Section A Items 8 ar	nd/or 9 (see pages	1–2 of Instructions),
the next higher floor (elevation C2.b in the diagrams) of the building is				or  below the HAG.
E3. Attached garage (top of slab) is		[] feet [] n	neters 🗌 above	or Delow the HAG.
E4. Top of platform of machinery and/or equipment servicing the building is		feetn	neters 🔲 above	or
E5. Zone AO only: If no flood depth number is available floodplain management ordinance? Yes	ole, is the top of the	e bottom floor elevated i wn.   The local official m	in accordance with nust certify this info	the community's ormation in Section G.
SECTION F - PROPERTY OW	NER (OR OWNER	R'S REPRESENTATIVE	E) CERTIFICATIO	N
The property owner or owner's authorized representat community-issued BFE) or Zone AO must sign here. T	ive who completes	Sections A. B. and E.fo	or Zone A (without	a FEMA-issued or
Property Owner or Owner's Authorized Representative				
Address	C	Dity	State	ZIP Code
Signature	Γ	Date	Telephone	
Comments				

# **ELEVATION CERTIFICATE**

OMB No. 1660-0008 Expiration Date: November 30, 2018

IMPORTANT: In these spaces, copy the corr	esponding information from Section A		FOR INSURANCE COMPANY USE
Building Street Address (including Apt., Unit, S 10006 Corinthian Drive	uite, and/or Bldg. No.) or P.O. Route and	Box No.	Policy Number:
City Borough of Stone Harbor	State ZIP Code New Jersey 08247		Company NAIC Number
SECTIO	ON G - COMMUNITY INFORMATION (O	PTIONAL)	
The local official who is authorized by law or or Sections A, B, C (or E), and G of this Elevation used in Items G8–G10. In Puerto Rico only, en	Certificate. Complete the applicable item ter meters.	n(s) and sign	below. Check the measurement
data in the Comments area below.)	ed by law to certify elevation information.	(Indicate the	e source and date of the elevation
or Zone AO.	on E for a building located in Zone A (wit		
G3. The following information (Items G4-	G10) is provided for community floodplai		1.00
G4. Permit Number	G5. Date Permit Issued	G6. E	Date Certificate of Compliance/Occupancy Issued
17-12506	9/18/17		7/31/18
G7. This permit has been issued for:	New Construction  Substantial Impro	ovement	
G8. Elevation of as-built lowest floor (including of the building:	basement)	<b>X</b> feet	meters Datum NAVD19&&
G9. BFE or (in Zone AO) depth of flooding at t		73	meters Datum Navo 1966
G10. Community's design flood elevation:		feet	meters Datum NOVO 1986
Local Official's Name	Title CONS	TRUE	TION OFFICIAL
Community Name  BOROUGH OF STO	Telephone	09.3	GE 684
Signature	Date	7/3/1	8
Comments (including type of equipment and loc	cation, per C2(e), if applicable)		
			Check here if attachments.

### **BUILDING PHOTOGRAPHS**

OMB No. 1660-0008 Expiration Date: November 30, 2018

<b>ELEVATION CERTIFICATE</b>	See Instructions	for Item A6.	Expiration Date: November 30, 2018
IMPORTANT: In these spaces, copy the cor	responding information	from Section A.	FOR INSURANCE COMPANY USE
Building Street Address (including Apt., Unit, \$ 10006 Corinthian Drive	Suite, and/or Bldg. No.) or	P.O. Route and Box No.	Policy Number:
City	State	ZIP Code	Company NAIC Number
Borough of Stone Harbor	New Jersey	08247	

If using the Elevation Certificate to obtain NFIP flood insurance, affix at least 2 building photographs below according to the instructions for Item A6. Identify all photographs with date taken; "Front View" and "Rear View"; and, if required, "Right Side View" and "Left Side View." When applicable, photographs must show the foundation with representative examples of the flood openings or vents, as indicated in Section A8. If submitting more photographs than will fit on this page, use the Continuation Page.

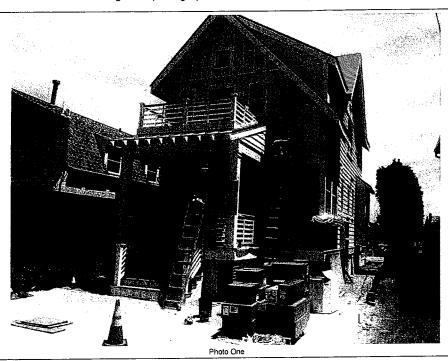


Photo One Caption Front View 6-26-18 Clear Photo One



Photo Two Caption Rear View 6-26-18 Clear Photo Two

# **BUILDING PHOTOGRAPHS**

**ELEVATION CERTIFICATE** 

Continuation Page

OMB No. 1660-0008

Expiration Date: November 30, 2018

IMPORTANT: In these spaces, copy t	ne corresponding information	from Section A.	FOR INSURANCE COMPANY USE
Building Street Address (including Apt., Unit, Suite, and/or Bldg. No.) or P.O. Route and Box No. 10006 Corinthian Drive		Policy Number:	
City	State	ZIP Code	Company NAIC Number
Borough of Stone Harbor	New Jersey	08247	

If submitting more photographs than will fit on the preceding page, affix the additional photographs below. Identify all photographs with: date taken; "Front View" and "Rear View"; and, if required, "Right Side View" and "Left Side View." When applicable, photographs must show the foundation with representative examples of the flood openings or vents, as indicated in Section A8.

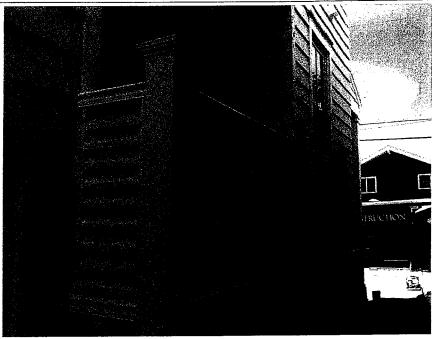


Photo Three

Photo Three Caption Rear View 6-26-18

Clear Photo Three



Photo Fou

Photo Four Caption Smart Vent 6-26-18

Clear Photo Four



# Most Widely Accepted and Trusted

# **ICC-ES** Report

ICC-ES | (800) 423-6587 | (562) 699-0543 | www.icc-es.org

**ESR-2074** 

Reissued 02/2017
This report is subject to renewal 02/2019.

DIVISION: 08 00 00—OPENINGS

SECTION: 08 95 43—VENTS/FOUNDATION FLOOD VENTS

### REPORT HOLDER:

# **SMARTVENT PRODUCTS, INC.**

430 ANDBRO DRIVE, UNIT 1 PITMAN, NEW JERSEY 08071

## **EVALUATION SUBJECT:**

SMART VENT® AUTOMATIC FOUNDATION FLOOD VENTS: MODELS #1540-520; #1540-521; #1540-510; #1540-511; #1540-570; #1540-574; #1540-524; #1540-514



Look for the trusted marks of Conformity!

"2014 Recipient of Prestigious Western States Seismic Policy Council (WSSPC) Award in Excellence"





A Subsidiary of CODE COUNCIL

ICC-ES Evaluation Reports are not to be construed as representing aesthetics or any other attributes not specifically addressed, nor are they to be construed as an endorsement of the subject of the report or a recommendation for its use. There is no warranty by ICC Evaluation Service, LLC, express or implied, as to any finding or other matter in this report, or as to any product covered by the report.





Copyright © 2017 ICC Evaluation Service, LLC. All rights reserved.



# **ICC-ES Evaluation Report**

**ESR-2074** 

Reissued February 2017

This report is subject to renewal February 2019.

www.icc-es.org | (800) 423-6587 | (562) 699-0543

A Subsidiary of the International Code Council®

DIVISION: 08 00 00-OPENINGS

Section: 08 95 43-Vents/Foundation Flood Vents

REPORT HOLDER:

SMARTVENT PRODUCTS, INC. 430 ANDBRO DRIVE, UNIT 1 PITMAN, NEW JERSEY 08071 (877) 441-8368 www.smartvent.com info@smartvent.com

### **EVALUATION SUBJECT:**

SMART VENT® AUTOMATIC FOUNDATION FLOOD VENTS: MODELS #1540-520; #1540-521; #1540-510; #1540-511; #1540-570; #1540-574; #1540-524; #1540-514

### 1.0 EVALUATION SCOPE

### Compliance with the following codes:

- 2015, 2012, 2009 and 2006 International Building Code® (IBC)
- 2015, 2012, 2009 and 2006 International Residential Code® (IRC)
- 2013 Abu Dhabi International Building Code (ADIBC)<sup>†</sup>

 $^{\dagger}$ The ADIBC is based on the 2009 IBC. 2009 IBC code sections referenced in this report are the same sections in the ADIBC.

#### Properties evaluated:

- Physical operation
- Water flow

#### 2.0 USES

The Smart Vent® units are engineered mechanically operated flood vents (FVs) employed to equalize hydrostatic pressure on walls of enclosures subject to rising or falling flood waters. Certain models also allow natural ventilation.

### 3.0 DESCRIPTION

### 3.1 General:

When subjected to rising water, the Smart Vent<sup>®</sup> FVs internal floats are activated, then pivot open to allow flow in either direction to equalize water level and hydrostatic pressure from one side of the foundation to the other. The FV pivoting door is normally held in the closed position by a buoyant release device. When subjected to rising water, the buoyant release device causes the unit to unlatch, allowing the door to rotate out of the way and allow flow.

The water level stabilizes, equalizing the lateral forces. Each unit is fabricated from stainless steel. Smart Vent® Automatic Foundation Flood Vents are available in various models and sizes as described in Table 1. The SmartVENT® Stacking Model #1540-511 and FloodVENT® Stacking Model #1540-521 units each contain two vertically arranged openings per unit.

# 3.2 Engineered Opening:

The FVs comply with the design principle noted in Section 2.7.2.2 and Section 2.7.3 of ASCE/SEI 24-14 [Section 2.6.2.2 of ASCE/SEI 24-05 (2012, 2009, 2006 IBC and IRC)] for a maximum rate of rise and fall of 5.0 feet per hour (0.423 mm/s). In order to comply with the engineered opening requirement of ASCE/SEI 24, Smart Vent FVs must be installed in accordance with Section 4.0.

# 3.3 Ventilation:

The SmartVENT® Model #1540-510 and SmartVENT® Overhead Door Model #1540-514 both have screen covers with ¹/₄-inch-by-¹/₄-inch (6.35 by 6.35 mm) openings, yielding 51 square inches (32 903 mm²) of net free area to supply natural ventilation. The SmartVENT® Stacking Model #1540-511 consists of two Model #1540-510 units in one assembly, and provides 102 square inches (65 806 mm²) of net free area to supply natural ventilation. Other FVs recognized in this report do not offer natural ventilation.

# 4.0 DESIGN AND INSTALLATION

SmartVENT® and FloodVENT® are designed to be installed into walls or overhead doors of existing or new construction from the exterior side. Installation of the vents must be in accordance with the manufacturer's instructions, the applicable code and this report. Installation clips allow mounting in masonry and concrete walls of any thickness. In order to comply with the engineered opening design principle noted in Section 2.7.2.2 and 2.7.3 of ASCE/SEI 24-14 [Section 2.6.2.2 of ASCE/SEI 24-05 (2012, 2009, 2006 IBC and IRC)], the Smart Vent® FVs must be installed as follows:

- With a minimum of two openings on different sides of each enclosed area.
- With a minimum of one FV for every 200 square feet (18.6 m²) of enclosed area, except that the SmartVENT® Stacking Model #1540-511 and FloodVENT® Stacking Model #1540-521 must be installed with a minimum of one FV for every 400 square feet (37.2 m²) of enclosed area.
- Below the base flood elevation.



with the bottom of the FV located a maximum of 12 inches (305.4 mm) above the higher of the final grade or floor and finished exterior grade immediately under each opening.

### 5.0 CONDITIONS OF USE

The Smart Vent<sup>®</sup> FVs described in this report comply with, or are suitable alternatives to what is specified in, those codes listed in Section 1.0 of this report, subject to the following conditions:

- 5.1 The Smart Vent® FVs must be installed in accordance with this report, the applicable code and the manufacturer's installation instructions. In the event of a conflict, the instructions in this report govern.
- 5.2 The Smart Vent<sup>®</sup> FVs must not be used in the place of "breakaway walls" in coastal high hazard areas, but

are permitted for use in conjunction with breakaway walls in other areas.

# 6.0 EVIDENCE SUBMITTED

Data in accordance with the ICC-ES Acceptance Criteria for Mechanically Operated Flood Vents (AC364), dated August 2015.

# 7.0 IDENTIFICATION

The Smart VENT® models recognized in this report must be identified by a label bearing the manufacturer's name (Smartvent Products, Inc.), the model number, and the evaluation report number (ESR-2074).

TABLE 1-MODEL SIZES

MODEL NAME	MODEL NUMBER	MODEL SIZE (in.)	COVERAGE (sq. ft.)
FloodVENT®	1540-520	15 <sup>3</sup> / <sub>4</sub> " × 7 <sup>3</sup> / <sub>4</sub> "	200
SmartVENT®	1540-510	15 <sup>3</sup> / <sub>4</sub> " X 7 <sup>3</sup> / <sub>4</sub> "	200
FloodVENT® Overhead Door	1540-524	15 <sup>3</sup> / <sub>4</sub> " × 7 <sup>3</sup> / <sub>4</sub> "	200
SmariVENT® Overhead Door	1540-514	15 <sup>3</sup> / <sub>4</sub> " X 7 <sup>3</sup> / <sub>4</sub> "	200
Wood Wall FloodVENT®	1540-570	14" X 8 <sup>3</sup> / <sub>4</sub> "	200
Wood Wall FloodVENT® Overhead Door	1540-574	14" X 8 <sup>3</sup> / <sub>4</sub> "	200
SmartVENT® Stacker	1540-511	16" X 16"	400
FloodVent® Stacker	1540-521	16" X 16"	400

For SI: 1 inch = 25.4 mm; 1 square foot = m<sup>2</sup>

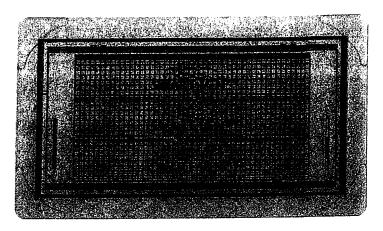


FIGURE 1-SMART VENT: MODEL 1540-510

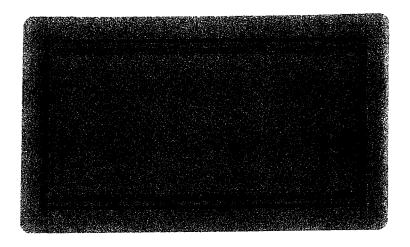


FIGURE 2-SMART VENT MODEL 1540-520

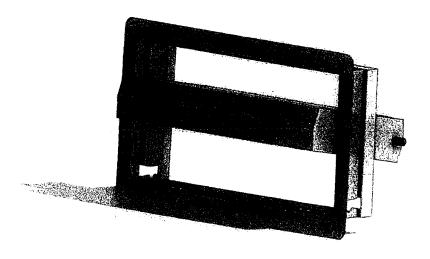


FIGURE 3-SMART VENT: SHOWN WITH FLOOD DOOR PIVOTED OPEN



# ICC-ES Evaluation Report

# ESR-2074 CBC and CRC Supplement

Issued January 2017

This report is subject to renewal February 2019.

www.icc-es.org | (800) 423-6587 | (562) 699-0543

A Subsidiary of the International Code Council®

DIVISION: 08 00 00-OPENINGS

Section: 08 95 43-Vents/Foundation Flood Vents

REPORT HOLDER:

SMARTVENT PRODUCTS, INC. 430 ANDBRO DRIVE, UNIT 1 PITMAN, NEW JERSEY 08071 (877) 441-8368 www.smartvent.com info@smartvent.com

### **EVALUATION SUBJECT:**

SMART VENT® AUTOMATIC FOUNDATION FLOOD VENTS: MODELS #1540-520; #1540-521; #1540-510; #1540-511; #1540-570; #1540-574; #1540-524; #1540-514

### 1.0 REPORT PURPOSE AND SCOPE

#### Purpose:

The purpose of this evaluation report supplement is to indicate that Smart Vent® Automatic Foundation Flood Vents, recognized in ICC-ES master evaluation report ESR-2074, have also been evaluated for compliance with codes noted below.

#### Applicable code edition:

- 2016 California Building Code (CBC)
- 2016 California Residential Code (CRC)

#### 2.0 CONCLUSIONS

### 2.1 CBC:

The Smart Vent® Automatic Foundation Flood Vents, described in Sections 2.0 through 7.0 of the master evaluation report ESR-2074, comply with 2016 CBC Chapter 12, provided the design and installation are in accordance with the 2015 International Building Code® (IBC) provisions noted in the master report and the additional requirements of CBC Chapters 12, 16 and 16A, as applicable.

The products recognized in this supplement have not been evaluated under CBC Chapter 7A for use in the exterior design and construction of new buildings located in any Fire Hazard Severity Zone within State Responsibility Areas or any Wildland-Urban Interface Fire Area.

### 2.2 CRC:

The Smart Vent® Automatic Foundation Flood Vents, described in Sections 2.0 through 7.0 of the master evaluation report ESR-2074, comply with the 2016 CRC, provided the design and installation are in accordance with the 2015 International Residential Code® (IRC) provisions noted in the master report.

The products recognized in this supplement have not been evaluated under 2016 CRC Chapter R337, for use in the exterior design and construction of new buildings located in any Fire Hazard Severity Zone within State Responsibility Areas or any Wildland-Urban Interface Fire Area.

The products\_recognized in this supplement have not been evaluated for compliance with the International Wildland-Urban Interface Code®

This supplement expires concurrently with the master report, reissued February 2017.





# **ICC-ES Evaluation Report**

# **ESR-2074 FBC Supplement**

Reissued February 2017 This report is subject to renewal February 2019.

www.icc-es.org | (800) 423-6587 | (562) 699-0543

A Subsidiary of the International Code Council®

DIVISION: 08 00 00-OPENINGS

Section: 08 95 43-Vents/Foundation Flood Vents

REPORT HOLDER:

SMARTVENT PRODUCTS, INC. 430 ANDBRO DRIVE, UNIT 1 PITMAN, NEW JERSEY 08071 (877) 441-8368 www.smartvent.com info@smartvent.com

#### **EVALUATION SUBJECT:**

SMART VENT® AUTOMATIC FOUNDATION FLOOD VENTS: MODELS #1540-520; #1540-521; #1540-510; #1540-511; #1540-570; #1540-574; #1540-524; #1540-514

#### 1.0 REPORT PURPOSE AND SCOPE

#### Purpose:

The purpose of this evaluation report supplement is to indicate that Smart Vent® Automatic Foundation Flood Vents, recognized in ICC-ES master report ESR-2074, have also been evaluated for compliance with the codes noted below.

### Applicable code editions:

- 2014 Florida Building Code—Building (FBC)
- 2014 Florida Building Code—Residential (FRC)

### 2.0 CONCLUSIONS

The Smart Vent® Automatic Foundation Flood Vents, described in Sections 2.0 through 7.0 of the master evaluation report ESR-2074, comply with the FBC and the FRC, provided the design and installation are in accordance with the *International Building Code®* provisions noted in the master report.

Use of the Smart Vent® Automatic Foundation Flood Vents has also been found to be in compliance with the High-Velocity Hurricane Zone provisions of the FBC and the FRC.

For products falling under Florida Rule 9N-3, verification that the report holder's quality assurance program is audited by a quality assurance entity approved by the Florida Building Commission for the type of inspections being conducted is the responsibility of an approved validation entity (or the code official when the report holder does not possess an approval by the Commission).


This supplement expires concurrently with the master report, reissued February 2017.



#### DIAGRAM 7

All buildings elevated on full-story foundation walls with a partially or fully enclosed area below the elevated floor. This includes walkout levels, where at least 1 side is at or above grade. The principal use of this building is located in the elevated floors of the building.


Distinguishing Feature – For all zones, the area below the elevated floor is enclosed, either partially or fully. In A Zones, the partially or fully enclosed area below the elevated floor is with or without openings\*\* present in the walls of the enclosure. Indicate information about enclosure size and openings in Section A – Property Information.



#### DIAGRAM 8

All buildings elevated on a crawlspace with the floor of the crawlspace at or above grade on at least 1 side, with or without an attached garage.


Distinguishing Feature – For all zones, the area below the first floor is enclosed by solid or partial perimeter walls. In all A zones, the crawlspace is with or without openings\*\* present in the walls of the crawlspace. Indicate information about crawlspace size and openings in Section A – Property Information.



### DIAGRAM 9

All buildings (other than split-level) elevated on a subgrade crawlspace, with or without attached garage.

Distinguishing Feature – The bottom (crawlspace) floor is below ground level (grade) on all sides.\* (If the distance from the crawlspace floor to the top of the next higher floor is more than 5 feet, or the crawlspace floor is more than 2 feet below the grade [LAG] on all sides, use Diagram 2A or 2B.)

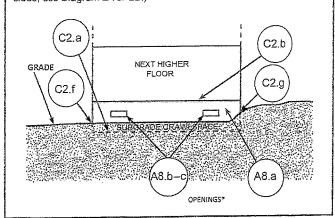

- \* A floor that is below ground level (grade) on all sides is considered a basement even if the floor is used for living purposes, or as an office, garage, workshop, etc.
- \*\* An "opening" is a permanent opening that allows for the free passage of water automatically in both directions without human intervention. Under the NFIP, a minimum of 2 openings is required for enclosures or crawlspaces. The openings shall provide a total net area of not less than 1 square inch for every square foot of area enclosed, excluding any bars, louvers, or other covers of the opening. Alternatively, an Individual Engineered Flood Openings Certification or an Evaluation Report issued by the International Code Council Evaluation Service (ICC ES) must be submitted to document that the design of the openings will allow for the automatic equalization of hydrostatic flood forces on exterior walls. A window, a door, or a garage door is not considered an opening; openings may be installed in doors. Openings shall be on at least 2 sides of the enclosed area. If a building has more than 1 enclosed area, each area must have openings to allow floodwater to directly enter. The bottom of the openings must be no higher than 1.0 foot above the higher of the exterior or interior grade or floor immediately below the opening. For more quidance on openings, see NFIP Technical Bulletin 1.

